

 <p>Blue Heaven Technologies</p> <p>2820 S. English Station Road - Louisville, KY 40299 Tel: (502) 357-0132 Fax (502) 267-8379</p>	<p>Date: 10-May-23 TEST NO. 23-222-3B</p> <p style="text-align: center;">ASHRAE Standard 52.2-2017 TEST REPORT</p> <p style="text-align: center;">Initial Efficiency / Resistance</p>
---	--


Filter Description	
Manufacturer	Essential Air Products
Filter Model	NovusAer 1200
Part Number	
Generic Filter Type	
Nominal Dimensions (H x W x D)	80" x 25" x 2"
Pocket / Pleat Quantity	Standard
Media Type	Synthetic
Est. Gross Media Area	Standard
Adhesive Type	N/A





Test Conditions			
Loading Dust Type	NA	Test Air Temp (degrees F.)	72
Barometric Pressure (In. Hg.)	29.42	Relative Humidity (%)	39

Test Results	
Airflow Rate (CFM)	1050
Nominal Face Velocity (fpm)	76/Filter
Initial Resistance (in WG)	0.30
E1 (%) Initial Efficiency 0.30 - 1.0 um	99.23
E2 (%) Initial Efficiency 1.0 - 3.0 um	99.37
E3 (%) Initial Efficiency 3.0 - 10.0 um	99.48
Estimated * Minimum Efficiency Reporting Value (MERV)	MERV 16 @ 1050 CFM
* If initial data is minimum	

Comments Tested For: Essential Air Products

Test Performed by: C Rees CAFS Approved By:  Manager Page 1 of 3

Important Note: Please be advised that the ASHRAE committee SSPC 52.2, in March 2016, has published "addendum e" relative to the 52.2-2012 test protocol. This addendum restricts the use of the acronym "MERV" as only applicable to a test report that has been completed using the "entire procedure prescribed by the standard". This report is a modified version of the procedure and therefore, subject to that ruling. In the best interest of our customers, Blue Heaven Technologies has elected to delay this action until further assessment can be made at committee level. Where applicable, the qualified use of the term "MERV" will continue to be part of our reported data.

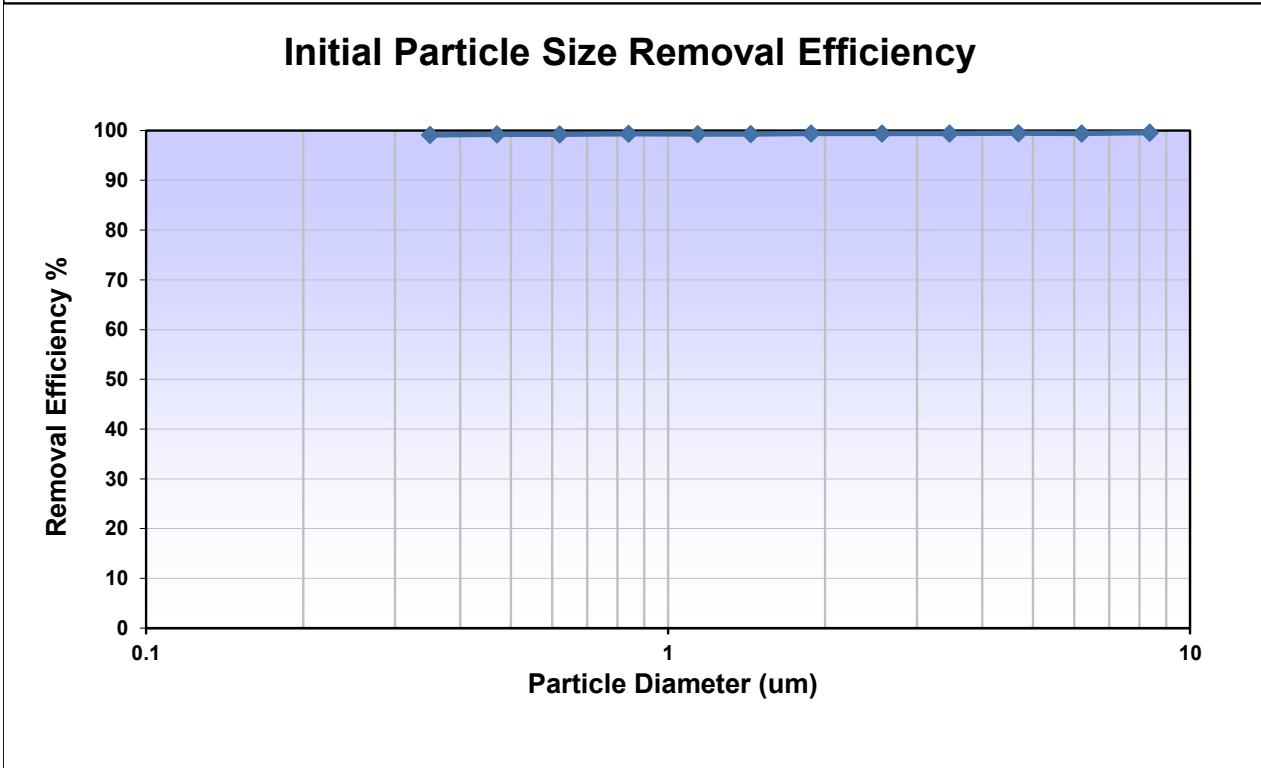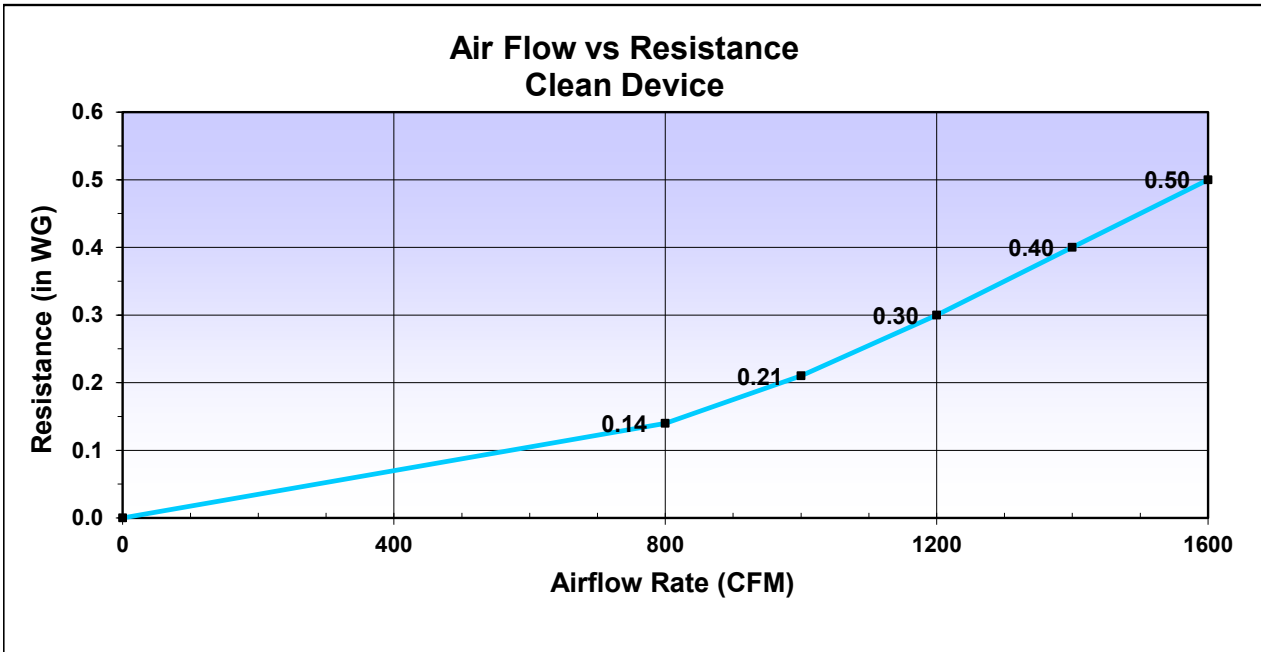

Test No. 23-222-3B
 Date: 10-May-23

Data - Initial Resistance

Airflow (CFM)	Resistance (in WG)
0	0.00
800	0.14
1000	0.21
1200	0.30
1400	0.40
1600	0.50

Test Flow

Data - Particle Removal Efficiency

Particle Size Range (um)	Geometric Mean Diam (um)	Initial Particle Removal Efficiency (%)
0.30 - 0.40	0.35	99.1
0.40 - 0.55	0.47	99.2
0.55 - 0.70	0.62	99.2
0.70 - 1.00	0.84	99.3
1.00 - 1.30	1.14	99.3
1.30 - 1.60	1.44	99.3
1.60 - 2.20	1.88	99.4
2.20 - 3.00	2.57	99.4
3.00 - 4.00	3.46	99.4
4.00 - 5.50	4.69	99.5
5.50 - 7.00	6.20	99.4
7.00 - 10.00	8.37	99.6